


### Flood Power Systems Heat Pump COP



The COP of this heat pump unit includes the input Power of the outdoor evaporator fan as well as the PLC power used to run the control system, sensors, etc. As the size of the unit increases, the power input for the PLC becomes negligible, further increasing the COP of the unit.

Heat Pump: Heat Out and COP vs Cold Outside Temperature

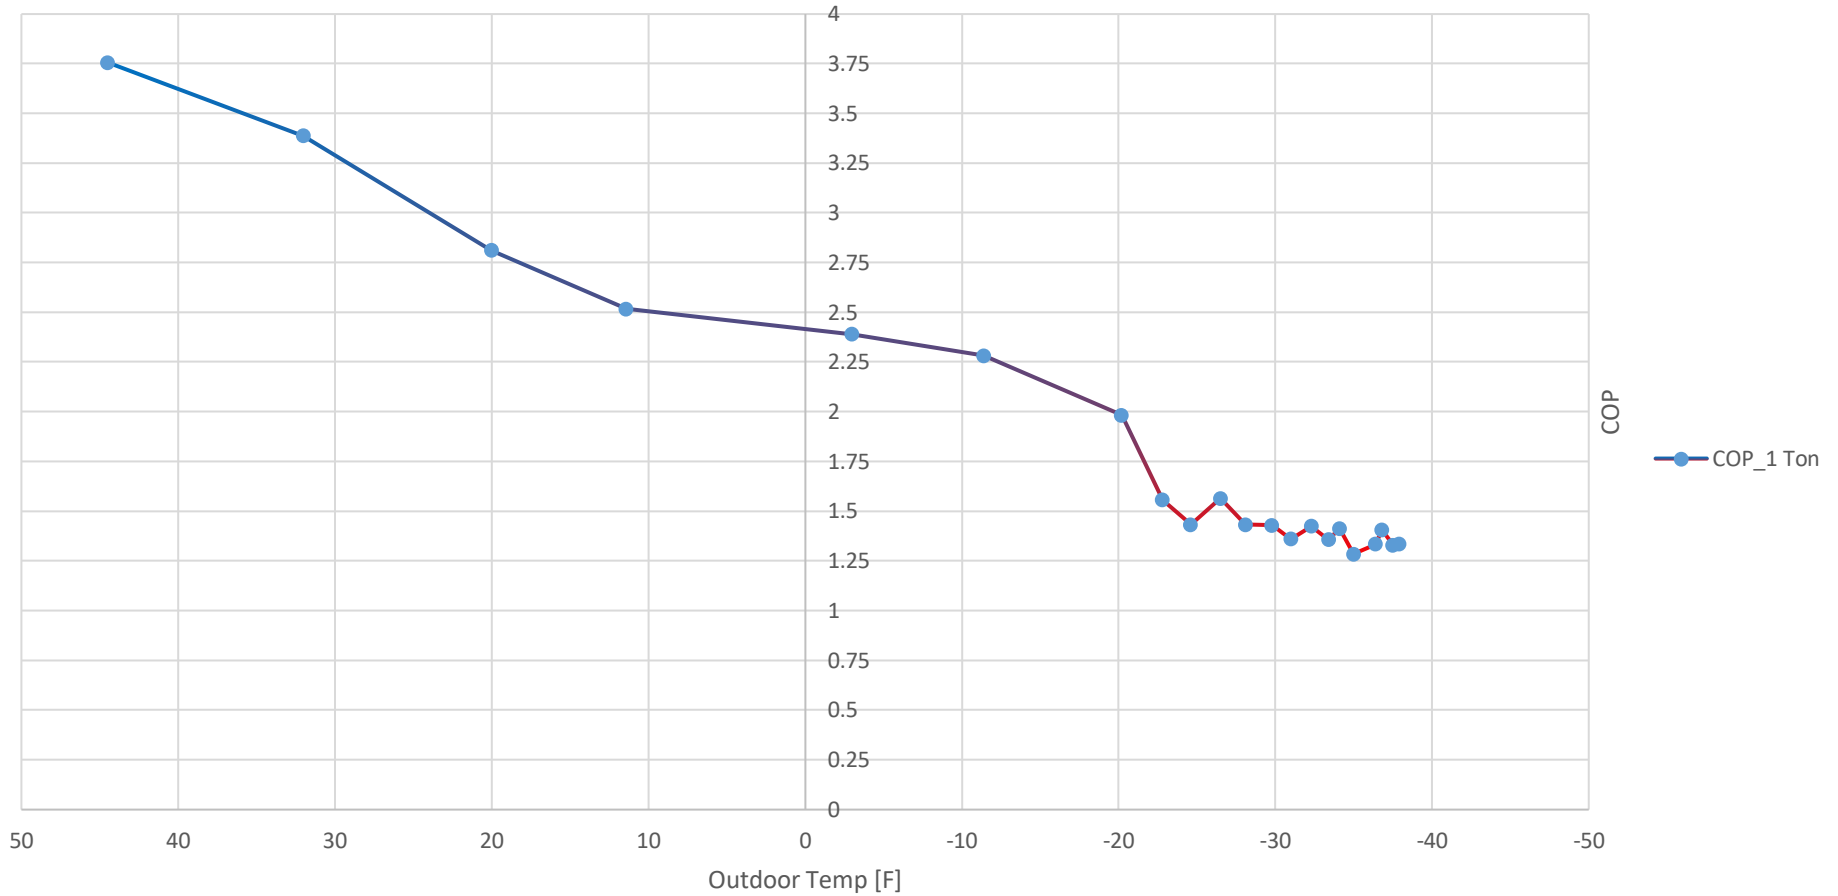